

Institution for testing, supervision  
and certification, officially  
recognized by the building supervi-  
sory authority. Approvals of new  
building materials, components and  
types of construction  
Research, development,  
demonstration and consulting in the  
fields of building physics

Directors  
Univ.-Prof. Dr. Gerd Hauser  
Univ.-Prof. Dr. Klaus Sedlbauer

## Test report P-BA 222/2013e

# Determination of the Acoustic Performance of a Wastewater Installation System in the Laboratory

**Client:** Wiitta Oy  
Suokannaksentie 1  
FI-18300 HEINOLA  
FINLAND

**Test specimen:** Wastewater installation system consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" (manufacturer: Walraven).

**Contents:** Table 1: Summary of test results  
Figures 1 to 3: Detailed results  
Figures 4 and 5: Test set-up  
Annex A: Measurement set-up, noise excitation,  
acoustic parameters  
Annex F: Evaluation of measurements  
Annex P: Description of test facility  
Annex V: Evaluation according to VDI 4100

The tests were performed in a laboratory accredited by the German Accreditation System for Testing (DAP, file no. PL-3743.26) according to standard EN ISO/IEC 17025.


Any publication of this document in part is subject to written permission by the Fraunhofer Institute of Building Physics (IBP).

Stuttgart, November 22, 2013

Bearbeiter

Prüfstellenleiter:

  
Dipl.-Ing. (FH) J. Mohr

  
Dr. rer. nat. L. Weber



# Determination of the installation sound level $L_{in}$ in the laboratory

P-BA 222/2013e  
Tabelle 1

**Client:** Wiitta Oy, Suokannaksentie 1, FI-18300 HEINOLA, FINLAND

**Test specimen:** Wastewater installation system (test specimen S 10628-01) consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" (manufacturer: Walraven).

**Test set-up:**

- The pipe system was mounted according to figure 4 (see also Annex A).
- The system consisted of wastewater pipes (nominal size OD 110), three inlet tees (90° Swept), two 45°-basement bends and a horizontal drain section. The inlet tees in the basement and in the ground floor were closed by lids supplied by the manufacturer. The pipe system was mounted by a technical firm.
- Pipe system: Single layer wastewater pipe fittings "Wiitta 110 mm PP EN-1451 S14", material PP-copolymer, size OD 110, wall thickness 3.8 mm, density  $\sim 0.900 \text{ g/cm}^3$  and single layer pipes "HT-PP 110 x 3.8 FL-Pipe", material PP-copolymer, size OD 110, wall thickness 3.8 mm, weight 1.14 kg/m, density  $\sim 0.900 \text{ g/cm}^3$  (values are manufacturers' information). Connection of the pipes by push-fit connection.
- Acoustic pipe clamps "Bismat 1000" (figure 5): Structure-borne sound insulating support attachment consisting of Bismat SL guidance clamp and Bismat SX socket clamp. In each storey (EG and UG) respectively two pipe clamps were installed. A loose clamp Bismat SL in the upper wall area and a Bismat 1000 double clamp (SX and SL) in the lower wall area. Two prevent contact to the pipe, the guidance clamp (SL) and the loose clamp (SL) were mounted with 15 mm space between the locking tabs of the clamp (two spacers on each side). The clamps were fixed to the installation wall with an adjustable wall plate with dowels and thread rods.

**Test facility:** Installation test facility P12, mass per unit area of the installation wall:  $220 \text{ kg/m}^2$ , installation rooms: sub-basement (KG), basement (UG) front, ground floor (EG) front and top floor (DG), measuring rooms: UG front, UG rear (details in Annex P and EN 14366: 2005-02)

**Test method:** The measurements were performed following German standard DIN 4109 and EN 14366; noise excitation by constant water flow with 0.5 l/s, 1.0 l/s, 2.0 l/s and 4.0 l/s (details in Annexes A and F).

## Results:

Wastewater installation system consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" (manufacturer: Walraven)

Flow rate [l/s]	0.5	1.0	2.0	4.0
Installation sound level $L_{Aeq,n} (L_{in})$ [dB(A)] <b>according to DIN 4109</b> measured in the basement test-room UG front	46	50	53	56
Installation sound level $L_{Aeq,n} (L_{in})$ [dB(A)] <b>according to DIN 4109</b> measured in the basement test-room UG rear	<10	13	18	21
Installation sound level $\overline{L}_{Aeq,nT} (L_{in})$ [dB(A)] <b>according to VDI 4100</b> measured in the basement test-room UG front	44	48	51	54
Installation sound level $\overline{L}_{Aeq,nT} (L_{in})$ [dB(A)] <b>according to VDI 4100</b> measured in the basement test-room UG rear	<10	10	14	18
Airborne sound pressure level $L_{a,A}$ [dB(A)] <b>according to EN 14366</b> in the basement test-room UG front	46	50	53	56
Structure-borne sound characteristic level $L_{sc,A}$ [dB(A)] <b>according to EN 14366</b> in the basement test-room UG rear	<10	<10	14	17

**Date of tests:** October 17, 2013

**Comments:**

- The requirements of DIN 4109 only apply for the test room UG rear.
- For the experimental setup investigated in the test facility the used supporting and fixing clips Bismat 1000 normally doesn't guarantee a realistic load transmission. Consequently, in case of practical application in a real building significant higher levels of installation noise may be expected.
- Sound levels below 10 dB(A) are not mentioned in the test report, since they are subject to an increased measurement uncertainty and moreover are not noticeable in a normal living environment.


 **Fraunhofer**  
IBP

The tests were performed in a laboratory accredited by the German Accreditation System for Testing (DAP, file no. PL-3743.26) according to standard EN ISO/IEC 17025.

Stuttgart, November 22, 2013  
Head of Laboratory:


*J. V. San Juan*



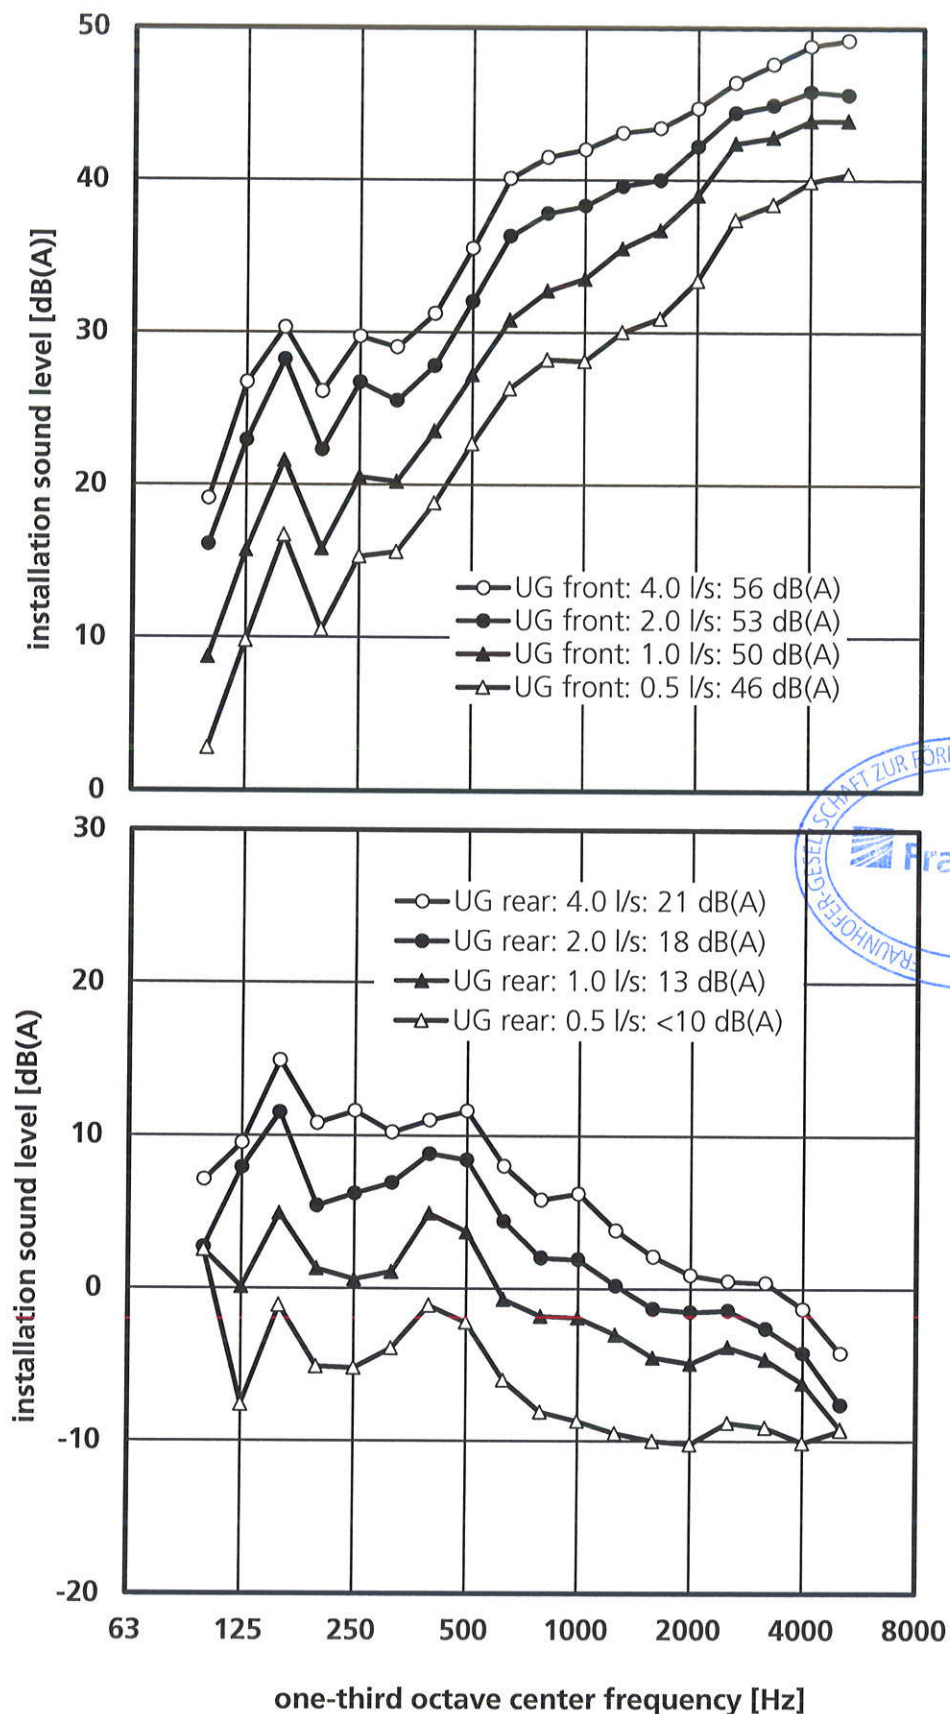


**Figure 1** Wastewater installation system consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" (manufacturer: Walraven) according to figure 4. The installation sound level  $L_{A\text{Freq},n}$  ( $L_{\text{in}}$ ) **according to DIN 4109** was measured at various flow rates in the test rooms UG front (above) and UG rear (below).

The tests were performed in a laboratory accredited by the German Accreditation System for Testing (DAP, file no. PL-3743.26) according to standard EN ISO/IEC 17025.

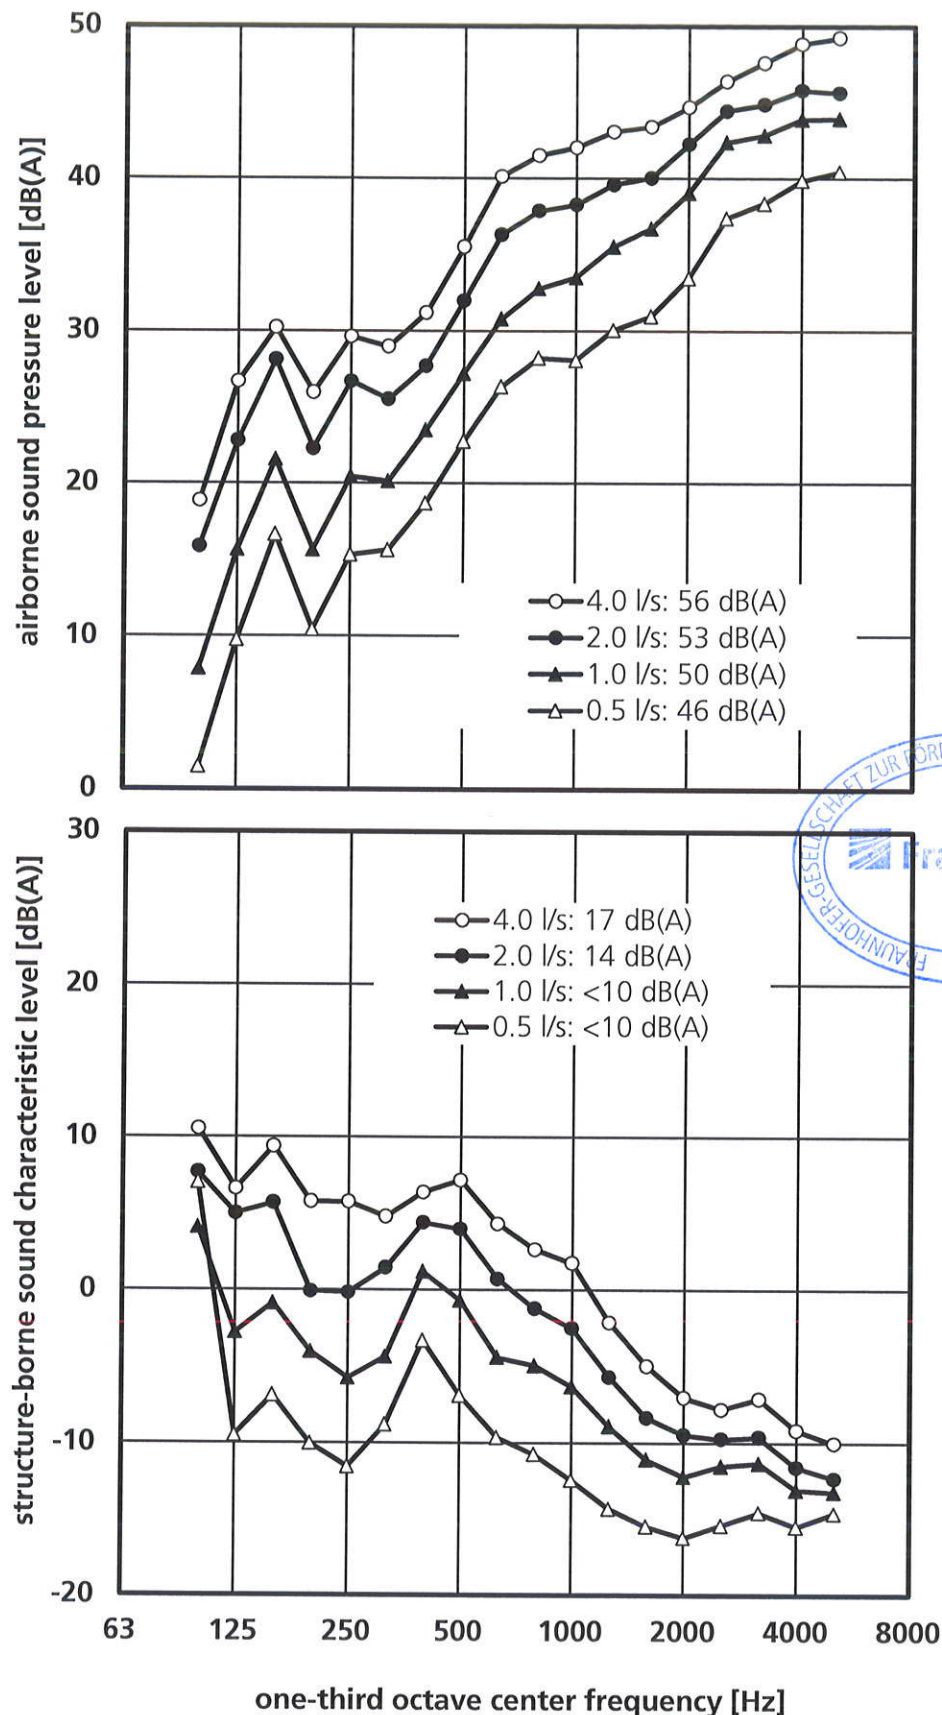

**Figure 2** Wastewater installation system consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" (manufacturer: Walraven) according to figure 4. Airborne sound pressure level  $L_{a,A}$  (above) and structure-borne sound characteristic level  $L_{s,c,A}$  (below) measured at various flow rates according to EN 14366.

The tests were performed in a laboratory accredited by the German Accreditation System for Testing (DAP, file no. PL-3743.26) according to standard EN ISO/IEC 17025.

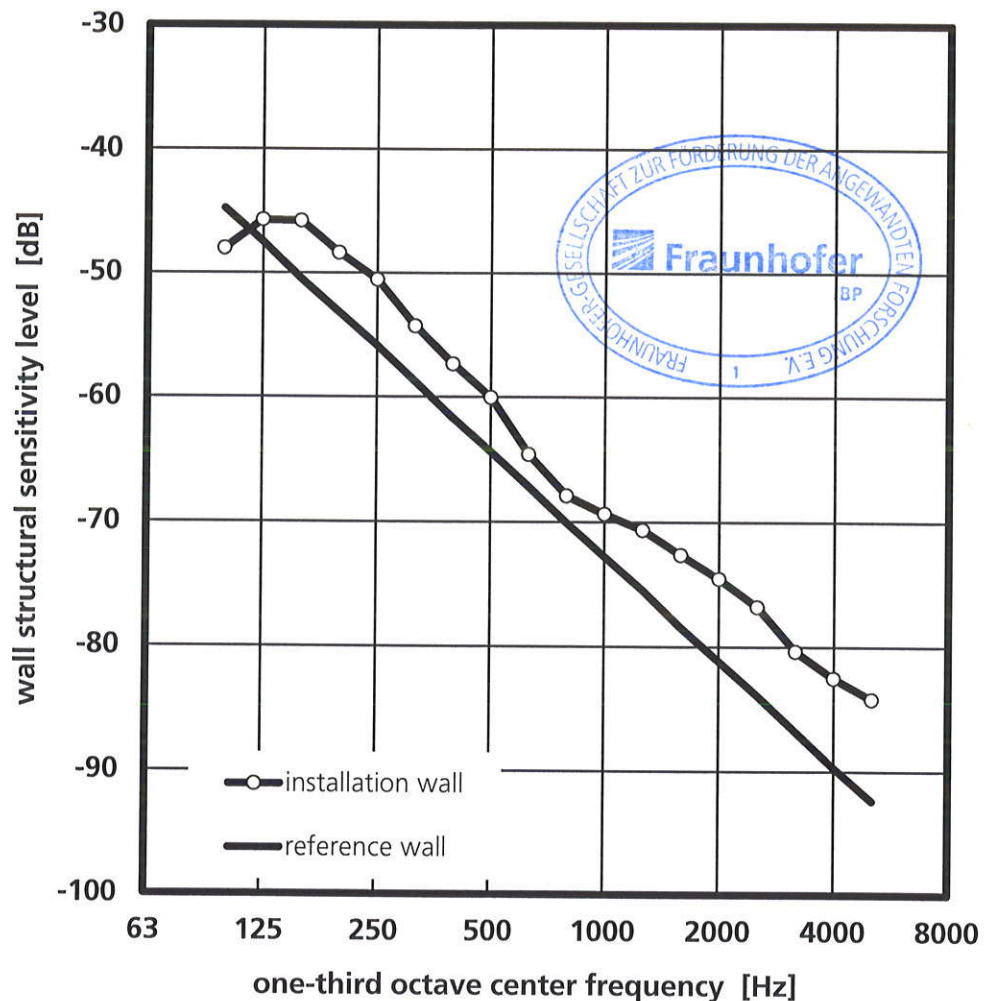

**Figure 3** Wall structural sensitivity level  $L_{SS}$  of the installation wall between the test rooms UG front and UG rear in the installation test facility in the Fraunhofer-Institute of Building Physics. The installation wall consists of lime stones (thickness 115 mm, ceiled on both sides) with a mass per unit area of  $220 \text{ kg/m}^2$ . The indicated structural sensitivity level  $L_{SS}$  refers to the mounting position of the waste water system according to figure 4. For comparison the wall structural sensitivity level  $L_{SSR}$  of the reference wall is also indicated (evaluation according to DIN EN 14366).

The tests were performed in a laboratory accredited by the German Accreditation System for Testing (DAP, file no. PL-3743.26) according to standard EN ISO/IEC 17025.





**Figure 4** Installation plan of the Wastewater installation system consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" (manufacturer: Walraven). Drawing not to scale, dimensions in mm.



**Figure 5** Wastewater installation system consisting of "110 mm PP EN-1451 S14" fittings (manufacturer: Wiitta Oy) and "HT-PP 110x3.8 S14" pipes (manufacturer: FL-Pipe Oy Ab) mounted with pipe clamps "Bismat 1000" made by Walraven (mounting details see test set-up).  
 Upper picture: Loose clamp "Bismat SL" in the upper wall area.  
 Lower picture: Double clamp "Bismat SL and Bismat SX" in the lower wall area.



## Measurement set-up, noise excitation and evaluation parameters

### Measurement set-up

In the water-installation test-facility run by the Fraunhofer Institute of Building Physics, a down pipe is installed leading from the top floor (DG) down to the sub-basement (KG) (for further details, please see Annex P). This down pipe is connected to a (OD 110) water inlet pipe on the top-floor level. The water is introduced through an S-shaped bend according to the standard EN 14366. In the sub-basement, the down pipe is connected to a bend (2 x 45 degree, usually) and merges into a horizontal discharge section, which in turn is joined to a water receptacle. The waste-water pipe on the ground floor (EG) and in the basement (UG) is fitted with conventional branches from main lines (usually, OD 110). Pipes and fittings are mounted according to the instructions given by the manufacturer. The air gaps between the tube and floor in the entrance and exit openings are stuffed with porous absorber in order to prevent any structure-borne sound bridges influencing the building. The waste-water piping is fastened to the installation wall (mass per unit surface  $m'' = 220 \text{ kg/m}^2$ ) by means of pipe clamps supplied by the Client, which are adapted to the external diameter of the pipes. The locations of the fixation points and further dimensions are specified in the installation plan that is included in the test report.

### Noise excitation and evaluation parameters

Any defined and metrological reproducible noise excitation requires steady state flow conditions inside the waste-water pipes. As the noise generation in waste water systems depends on the flow rate, noise measurements are performed at several flow rates  $Q$  which are typically encountered in practice:

- (1)  $Q = 0.5 \text{ l/s}$ , corresponding to  $Q = 30 \text{ l/min}$ ,
- (2)  $Q = 1.0 \text{ l/s}$ , corresponding to  $Q = 60 \text{ l/min}$ ,
- (3)  $Q = 2.0 \text{ l/s}$ , corresponding to  $Q = 120 \text{ l/min}$ ,
- (4)  $Q = 4.0 \text{ l/s}$ , corresponding to  $Q = 240 \text{ l/min}$ .

Here, a flow rate of  $Q = 2.0 \text{ l/s}$  roughly corresponds to the average flow rate required for flushing a toilet. According to Prandtl-Colebrook, the highest flow rate used results from the admissible hydraulic charge of the horizontal pipe sections, which is  $Q_{\max} = 4 \text{ l/s}$  for OD 110 pipes.

The measurements take place in the installation room (UG front) and in the room behind the installation wall (UG rear). The water flow generates vibrations of the wastewater pipe. These vibrations are transmitted to the installation wall through pipe clamps and/or other structure-borne sound bridges (e.g. fire protection sleeves), and then radiated by the wall (and to a lesser extent, also by the adjoining building parts) as airborne sound into the test room behind the installation wall. In the test room UG front additionally the airborne sound which is radiated from the waste water system is measured. According to EN ISO 140-3 the sound pressure level is picked up at six points in the room, to be space and time-averaged and corrected for the background noise. With this value the airborne sound pressure level  $L_{a,A}$  and the structure-borne sound characteristic level  $L_{sc,A}$  is calculated according to EN 14366. The installation sound level is determined following Annex F. Thereby the rounded  $L_{AF,10}$  is equivalent to the installation sound level  $L_{in}$  (or  $L_{AFmax,n}$ ) according to DIN 52219, DIN EN ISO 10052, DIN 4109-11 and DIN 4109.



## Evaluation of Measurements

### Stationary noise

The measured sound pressure level is given as time and space averaged one-third octave spectrum in the frequency range between 100 Hz and 5 kHz. First, the measured value is corrected for background noise. Subsequently, it is normalized to an equivalent sound absorption area of  $A_0 = 10 \text{ m}^2$  and A-weighted:

$$(1) \quad L_{n,AF,10} = 10 \cdot \lg \left( 10^{\frac{L_{n,f}}{10}} - 10^{\frac{L_{n,s}}{10}} \right) + 10 \cdot \lg \frac{A_n}{A_0} + k(A)_n \quad [\text{dB(A)}]$$

$L_{n,f}$	space and time averaged sound pressure level in one-third octave band n (time constant: fast)	[dB]
$L_{n,s}$	background noise level in one-third octave band n	[dB]
$A_n = \frac{0.16 \cdot V}{T_n}$	sound absorption area of test room for one-third octave band n	[m <sup>2</sup> ]
$V$	volume of test room	[m <sup>3</sup> ]
$T_n$	reverberation time of test room in one-third octave band n	[s]
$k(A)_n$	A-weighting for one-third octave band n	[dB]


If the difference between the measured one-third octave level and the background noise level is less than 3 dB, the correction for background noise will not be performed. Instead, the measured background noise level will be used as test result (as largest possible value). The total sound pressure level is obtained by energetically adding the one-third octave values.

$$(2) \quad L_{AF,10} = 10 \cdot \lg \left( \sum_{n=1}^{18} 10^{\frac{L_{n,AF,10}}{10}} \right), \quad [\text{dB(A)}]$$

where n indicates the number of one-third octave bands from 100 Hz to 5 kHz. The calculated level  $L_{AF,10}$  corresponds to the sound pressure level that would arise in a sparsely furnished reception room under otherwise equal conditions. The value ( $L_{AF,10}$ ) represents the installation sound level  $L_{in}$  (or  $L_{AFmax,n}$ ) in the test facility.

### Time-dependent noise

In this case, the measurement signal consists of a series of one-third octave spectra (frequency range from 100 Hz through 5 kHz) which are consecutively measured at the same place with a time interval of 0.128 s. The evaluation is performed in the same way as in the case of stationary noise, with the exception that background noise correction is not performed. After evaluation the maximum value ( $L_{AF,10,max}$ ) is determined from the measured time response.

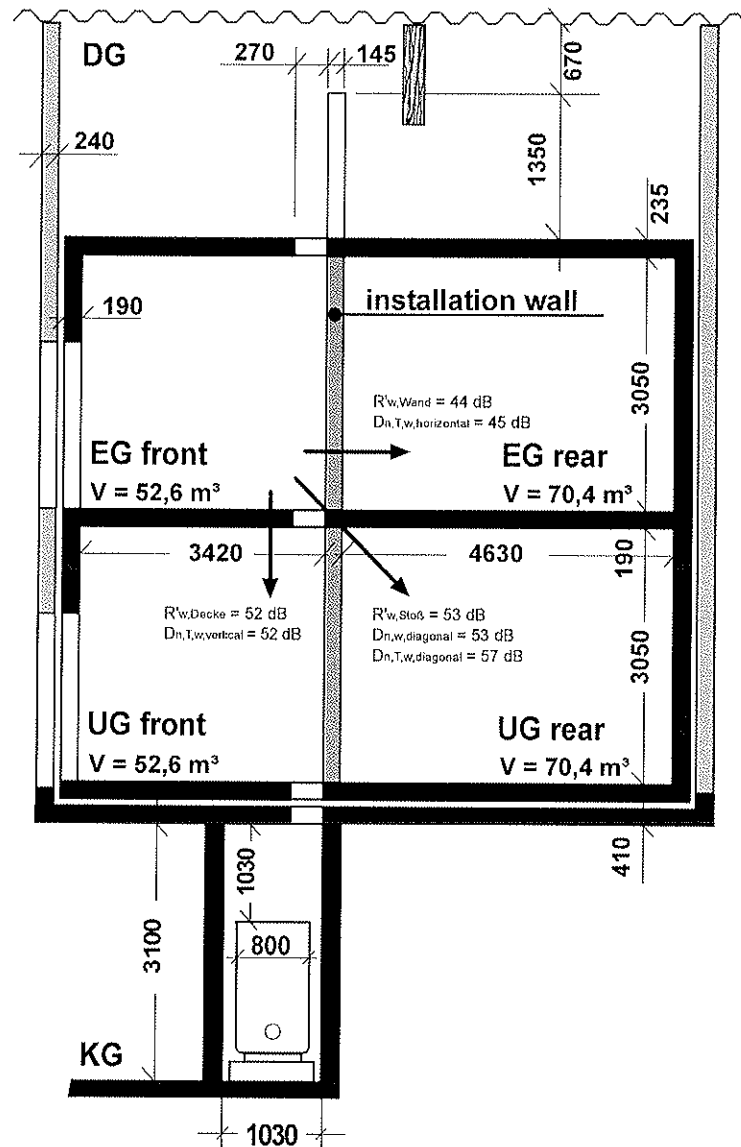

Sectional drawing of the installation test facility in the Fraunhofer-Institute of Building Physics (dimensions given in mm). The test facility comprises two couples of rooms in the ground floor (EG) and in the basement (UG) that are located above each other. Due to this construction, including the top floor (DG) and the sub-basement (KG), it is possible to perform tests on installation systems which extend across several floors, e.g. waste-water installation systems. The installation walls in the ground floor and in the basement can be substituted according to actual requirements. In the standard case, single-leaf solid walls with a mass per unit area of  $220 \text{ kg/m}^2$  (according to German standard DIN 4109) are used. Since the sound insulation of these walls do not meet the requirements to be fulfilled by a wall separating different occupancies within the same building ( $R'_w \geq 53 \text{ dB}$ ), the next adjacent rooms to be protected from noise are located diagonally above or below the installation room (in case of a usual design of the ground plan). Due to its double-leaf construction with an additional structure-borne sound insulation, the installation test facility is particularly suited for measuring low sound pressure levels. The measuring rooms are designed in such a way that the reverberation times are between 1 s and 2 s within the examined frequency range. The flanking walls, with an average mass per unit area of approximately  $440 \text{ kg/m}^2$ , are made of concrete.



### Assessment of increased noise protection according to VDI 4100

The directive VDI 4100 contains suggestions for increased sound insulation in apartments. These suggestions outreach the minimum requirements of DIN 4109, and in addition, can be agreed by the client and the responsible company.

The measurement of noise of sanitary installations is equally carried out in accordance with VDI 4100 and DIN 4109. Details of the method and the evaluation of the results are described in Annex F. The only difference between the two standards is that the measured sound levels in DIN 4109 are related to the equivalent sound absorption area of  $A_0 = 10 \text{ m}^2$ , whereas in VDI 4100 the reverberation time of  $T_0 = 0.5 \text{ s}$  is used as a reference value. The relation between the two sound levels is as follows:

$$L_{AF,nT} = L_{AF,n} - 10 \lg(V) + 15$$

with  $L_{AF,nT}$  = standardized sound level of noise of sanitary installations according to VDI 4100 [dB(A)]  
 $L_{AF,n}$  = normalized sound level of noise of sanitary installations according to DIN 4109 [dB(A)]  
 $V$  = volume of the receiving room [ $\text{m}^3$ ]


The indices A and F describe the frequency weighting "A" and the time weighting "Fast". Depending on whether a time-averaged value or a maximum level is measured, the index "eq" or "max" is added to these indices. This equally applies for the standardized and normalized sound level, for example  $L_{AFeq,nT}$  or  $L_{AFmax,n}$ .

The standardized sound level according to VDI 4100 and the normalized sound level according to DIN 4109 differ in a constant value which is only dependent on the volume of the receiving room. Whereas the normalized sound level (DIN 4109) is independent of the room volume, the standardized sound level (VDI 4100) is reduced by an increasing room volume. Since the requirements of sound insulation of VDI 4100 are related to the standardized sound level, the values measured in the test facilities of noise of sanitary installations of the IBP must be converted to the volume of the in-situ rooms in need of protection as verification of the requirements. Conversion is carried out according to the following relation:

$$L_{AF,nT,Building} = L_{AF,nT,Lab} + 10 \lg(V_{Lab}/V_{Building})$$

with  $L_{AF,nT,Building}$  = standardized sound level of the tested installation at the building  
 $L_{AF,nT,Lab}$  = standardized sound level of the tested installation in the test facility  
 $V_{Lab}$  = volume of the receiving room in the test facility  
 $V_{Building}$  = volume of the room in the building in need of protection

The volumes of the three receiving rooms in the sanitary installation noise test facility of the IBP and diagrams of the previous calculation formula for direct reading of the results can be found in the following:

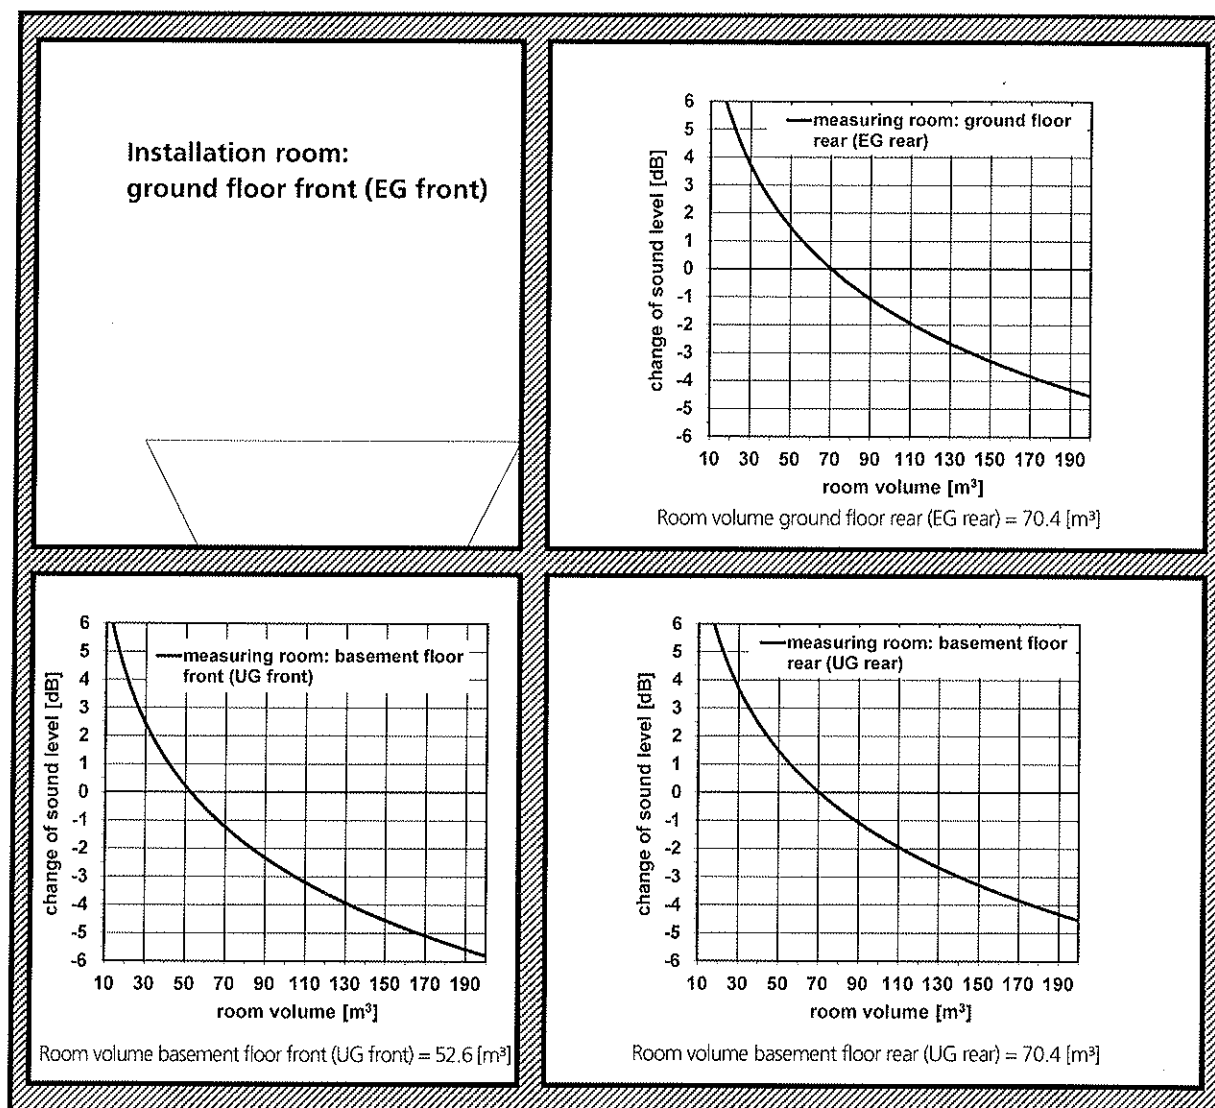

**Fig. 1:** Modification of the standardized sound level measured in the installation test facility P12 for rooms with deviating volume. The resulting change of sound level in comparison to the measured value indicated in the test report in dependence of the new room volume is specified in the diagrams for the three measuring rooms basement floor front (UG front), basement floor rear (UG rear), and ground floor rear (EG rear). If the volumes of the new room comply with the respective measuring room, the sound level will remain unchanged (modification of level  $\Delta L = 0$  dB). If the new room is larger than the respective measuring room, the sound level will be reduced ( $\Delta L < 0$ ). If it is smaller, the sound level will increase ( $\Delta L > 0$ ).

### Requirements

According to VDI 4100 all rooms in an apartment with a ground area  $\geq 8$  m<sup>2</sup> are considered as rooms in need of protection. Kitchens, bathrooms, WCs, halls and side rooms, however, are explicitly exempted from building installation noise and from impact sound. For common floor plan configuration (bathroom above bathroom) normally the room in the basement floor rear (UG rear) is for the values measured in the test facility the one to be primarily considered as room in need of protection.



The required values are divided according to the sound insulation levels (SSt) in VDI 4100 complying with various comfort levels:

**Table 1:** Comfort level and acoustic situation for the sound insulation levels I to III according to VDI 4100.

<b>SSt I</b>	„raised in the design and construction compared to a simple one regarding design and construction features“
	„unreasonable annoyance are in general avoided “
<b>SSt II</b>	„average requirements of comfort“
	„in general not disturbing“
<b>SSt III</b>	„special comfort requirements“
	„not or only seldom disturbing“

Different requirements are indicated respectively for the three sound protection levels in VDI 4100. Since sound insulation level III represents the highest comfort level the strictest requirements must be applied, i.e. sound levels allowable for noise of sanitary installations are lowest in this case. The required values for apartment houses or one-family terrace houses and one-family semi-detached houses are represented in the following table:

**Table 2:** The requirements of sound insulation of building service equipment in for apartment houses or one-family terrace houses and one-family semi-detached houses according to VDI 4100 for sound protection levels I to III. The requirements apply for sound transmission between separated apartments. Noise from water supply installations and sewage systems are considered together.

Building	Acoustic parameter [dB(A)]	Sound protection level I	Sound protection level II	Sound protection level III
Apartment houses	$\overline{L_{AFmax,nT}}$ or $\overline{L_{AFeq,nT}}$ a) b)	$\leq 30$	$\leq 27$	$\leq 24$
One-family terrace houses and one-family semi-detached houses	$\overline{L_{AFmax,nT}}$ or $\overline{L_{AFeq,nT}}$ a) b)	$\leq 30$	$\leq 25$	$\leq 22$

- a) Individual short-term noise peaks during actuation (opening, closing, adjusting, interrupting, etc.) the fittings and equipment of the plumbing system should not exceed the characteristic values of SSt II and SSt III by more than 10 dB. Here, the intended use is required
- b) Since noise of sanitary installations are frequently temporary changing signals, VDI 4100 provides for the measurement the maximum level  $\overline{L_{AFmax,nT}}$ . For stationary signals such as impact noise from water jets, however, it is more efficient to determine the average noise level  $\overline{L_{AFeq,nT}}$  instead, since only in this way it is possible to observe the requirements for reproducibility and accuracy obligatory for measurements in the test facility. The measured average noise level is generally slightly lower than the maximum level, however, the difference is not more than a maximum of 2 to 3 dB according to extensive experience.

Besides the previously described requirements for sound transmission between separate apartments, VDI 4100 also contains recommendations for sound protection in one's own living space. The effective required values and the importance of the respective sound protection levels can be found in VDI 4100.

Note to handle noise emitted by users in VDI 4100:

For user noises, which often result in complaints ( e.g. putting down a toothbrush tumbler on a storage board, opening and closing the toilet cover, use of toilets, sliding in the bath tub, striking the doors – also of wall cabinets and built-in cabinets, etc.) neither to the noise control classes SSt II and SSt III no characteristic values were specified, since these noises are very difficult to reproduce and depend on the specific building situation. It is assumed, however, that these noises – by intended use – are reduced as much as possible by application of conventional arrangements for the impact sound insulation when mounting the sanitary equipment.